


## HONEYWELL FS-90 CENTRAL FIRE SYSTEM

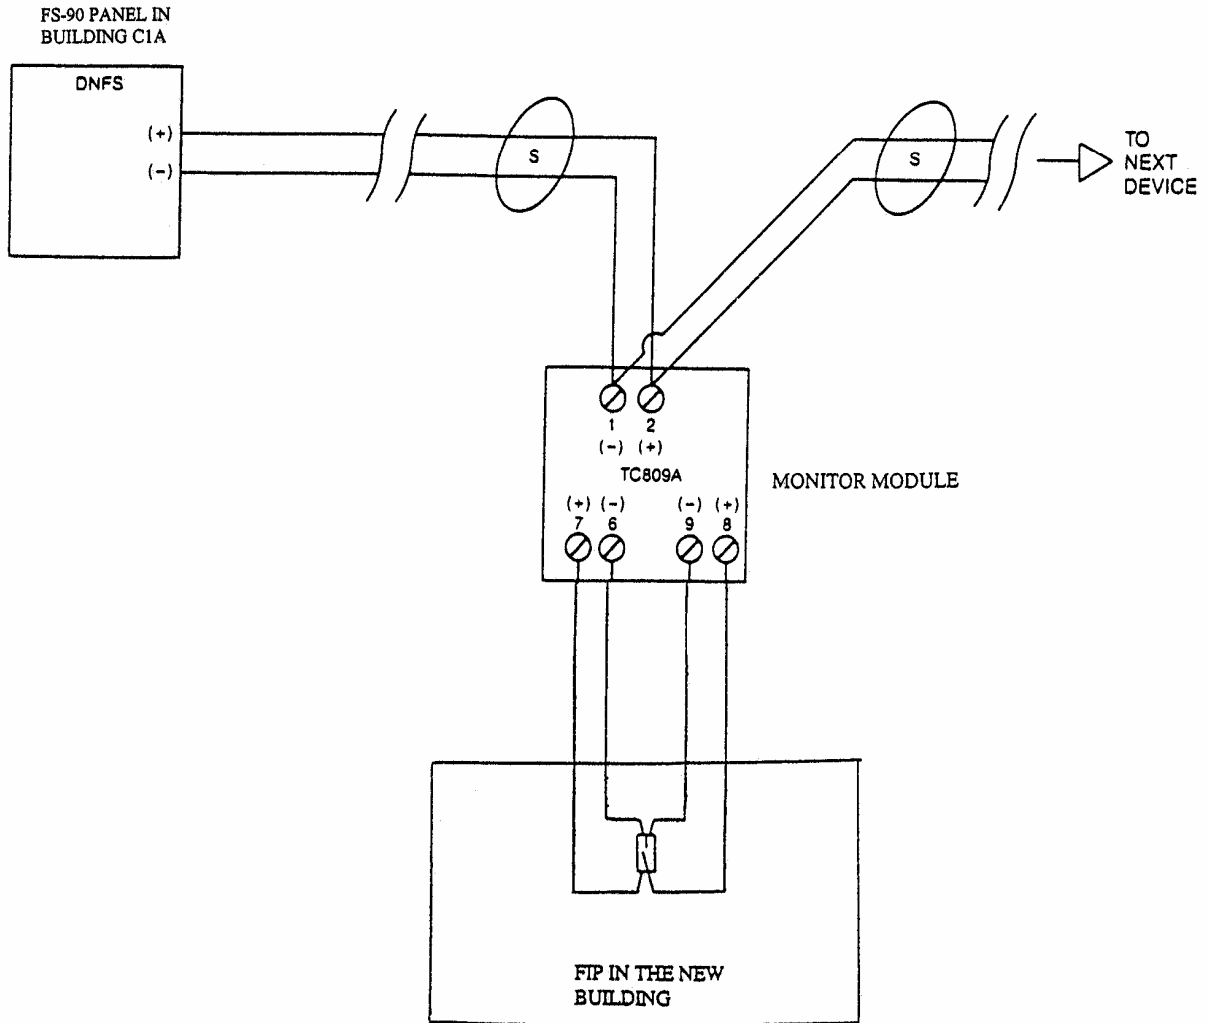

NOTE: 2 pair are connected to the Fire Indication Panel relay. The detection loop to the relay is a fault tolerant loop with an open circuit in any wire resulting in a system fault. A short circuit between positive and negative module outputs result in a call to the Fire Brigade.